


Current Project Construction Area (shown by the areas the the thick red border) for the month of October will be interconnection to the existing system at Oneida Ave. and Cleveland Dr., the installation of storm drainage improvements at various locations, the testing of the new mains from Oneida Ave. and north, and the start of the interconnection to the existing main on Benedict Ave.

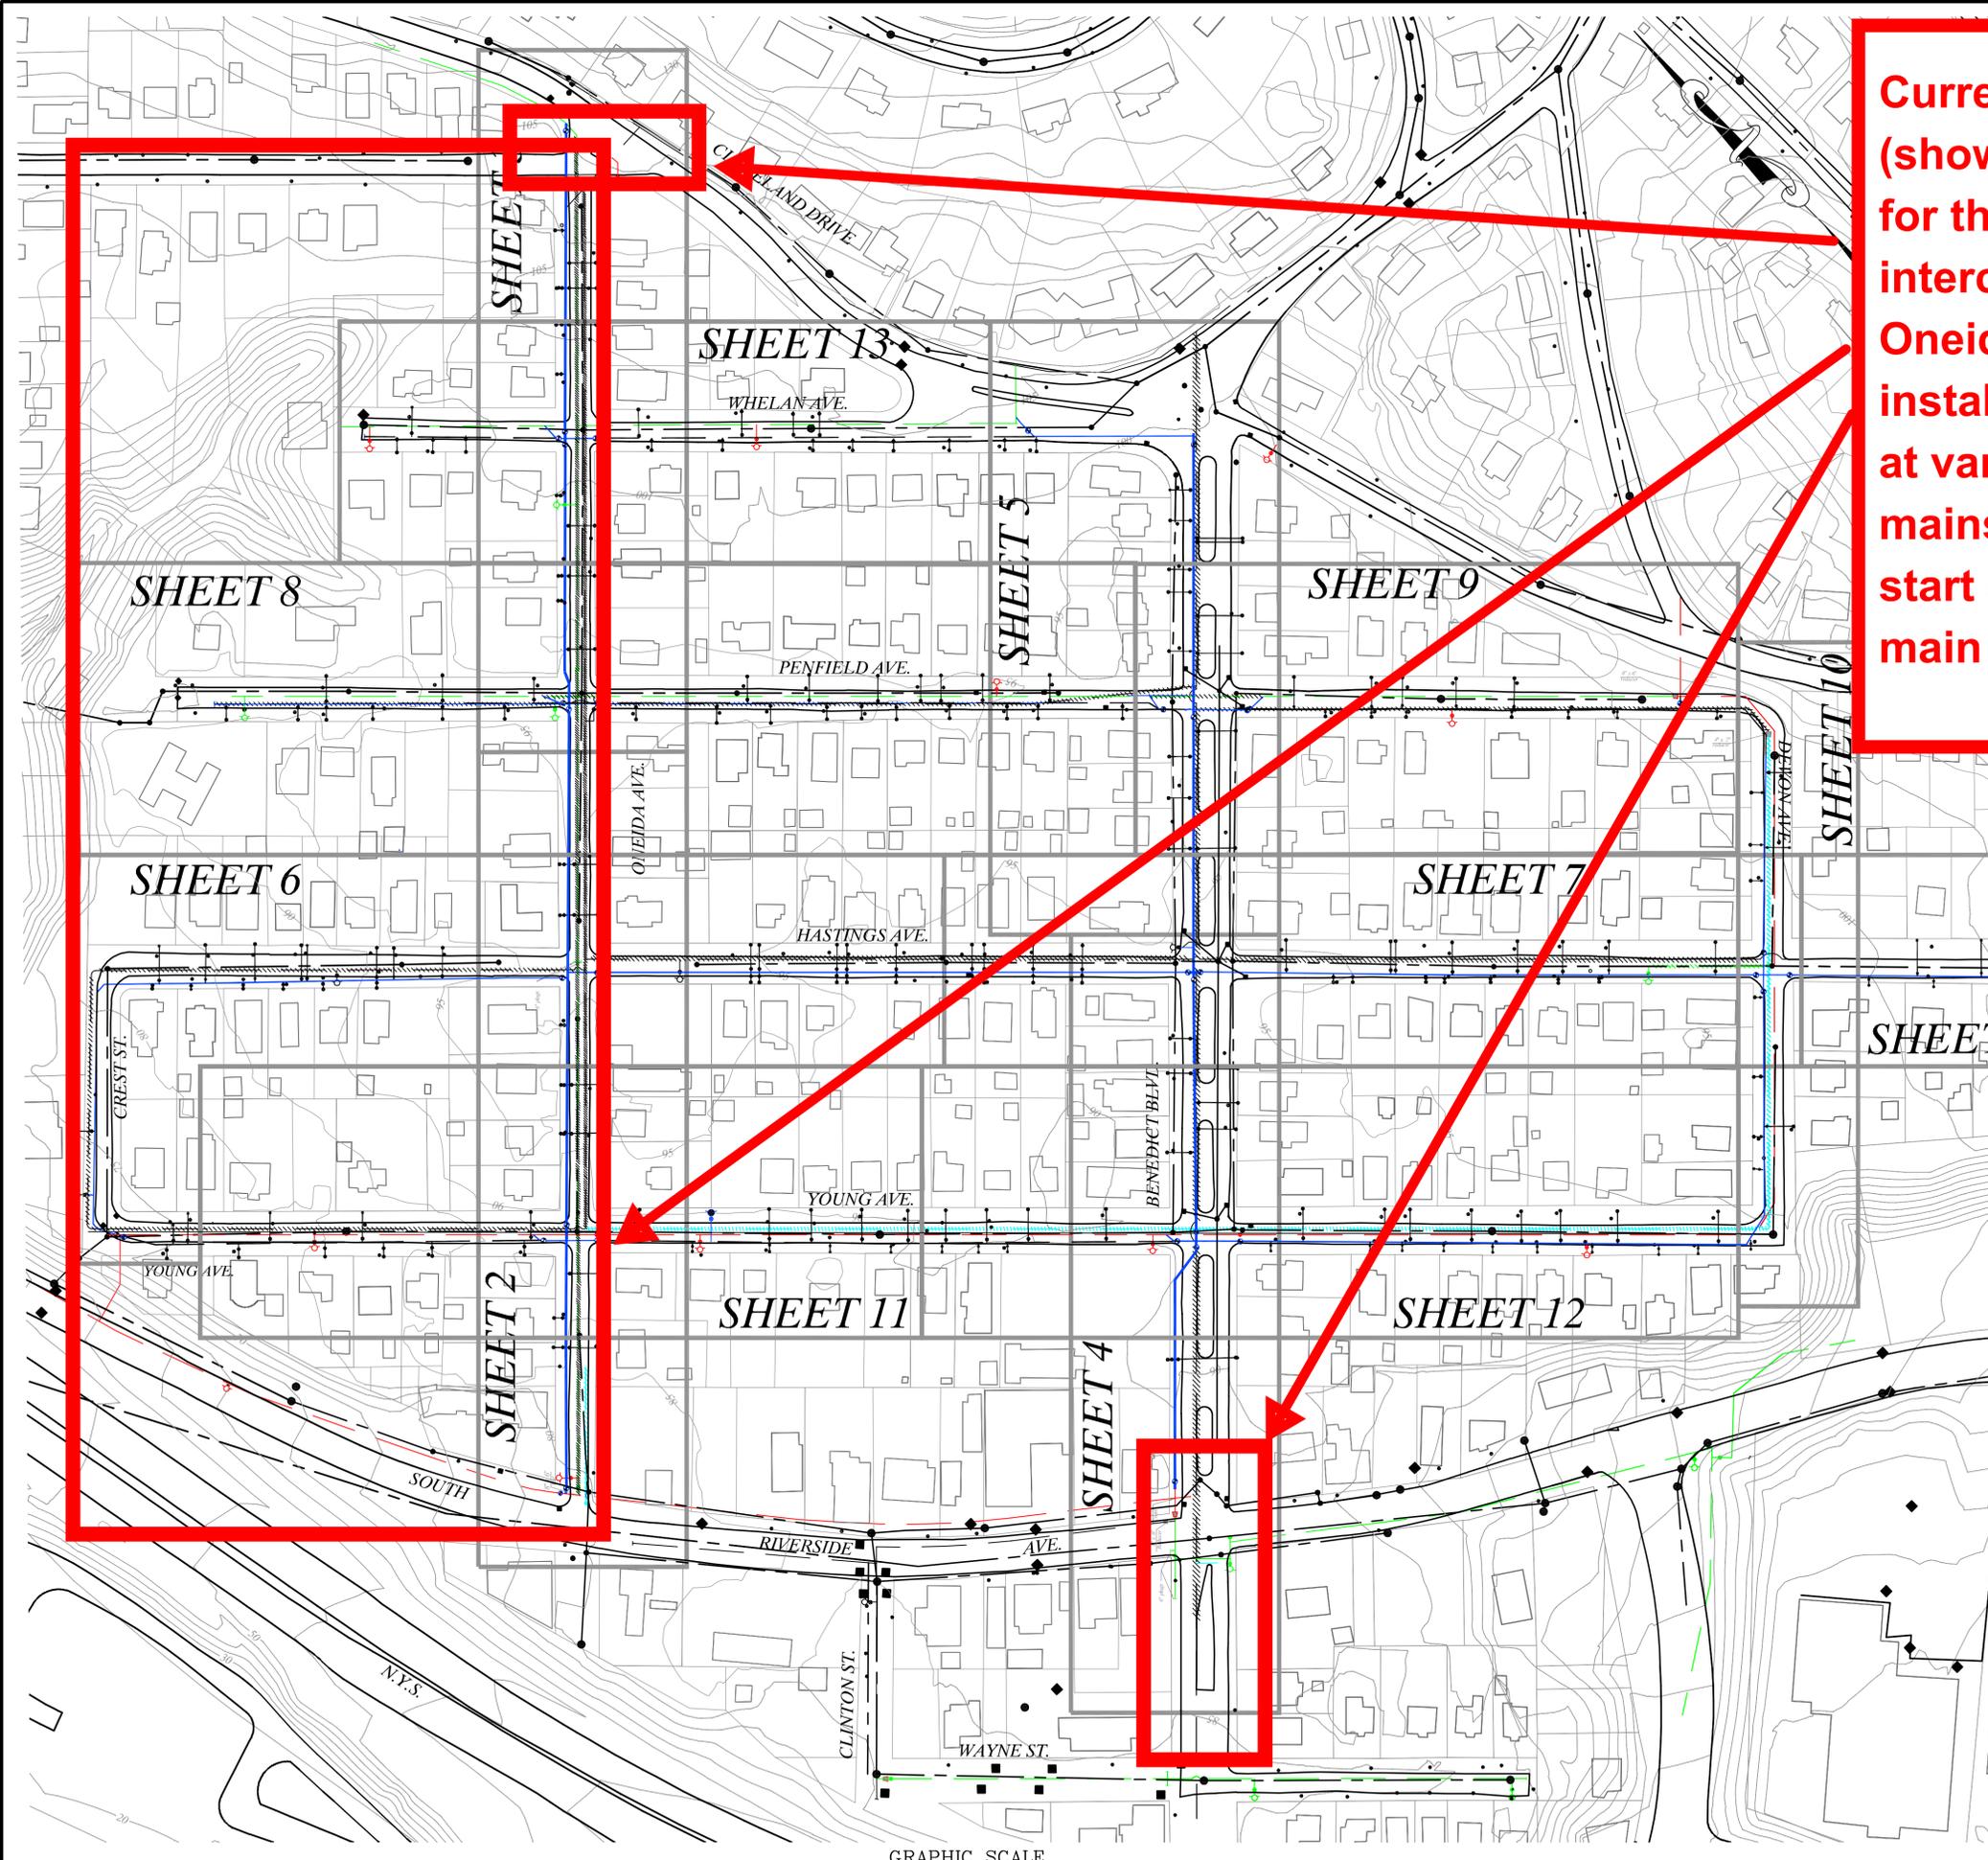

N/F HISTORIC HUDSON VALLEY
CONSTRUCTION STAGING AREA
SEE SPECIFICATIONS FOR
CONDITIONS OF USE

- NOTES:**
- EXISTING TOPOGRAPHIC MAPPING FROM VILLAGE OF CROTON ON HUDSON GIS SURVEY.
 - EXISTING UTILITIES FROM VILLAGE OF CROTON ON HUDSON GIS SURVEY.
 - CONTRACTOR TO NOTIFY ALL UTILITY COMPANIES PRIOR TO START OF WORK TO FIELD LOCATE EXISTING UTILITIES.
 - PRIOR TO ANY CONSTRUCTION RELATED ACTIVITIES, THE CONTRACTOR SHALL COMPLY WITH INDUSTRIAL CODE RULE 53, TELEPHONE # 800-245-2828.
 - ALL PROPOSED WATER MAINS SHALL BE CEMENT LINED DUCTILE IRON PIPE, PRESSURE CLASS 54.
 - PROPOSED WATER SERVICE LOCATIONS ARE FOR ESTIMATING PURPOSES ONLY.
 - UNLESS OTHERWISE NOTED, ALL WATER SERVICES ARE TO BE 3/4" COPPER.


PROPOSED WATER MAIN REPAIRS AND IMPROVEMENTS TO THE VILLAGE OF CROTON ON HUDSON WATER DISTRIBUTION SYSTEM

VILLAGE OF CROTON ON HUDSON WESTCHESTER CO., N.Y.

Kellard Engineering & Consulting, P.C.
CIVIL ENGINEERS • SITE & ENVIRONMENTAL PLANNERS

500 Main Street • Armonk, N.Y. 10504
(914) 273-2323

5	APRIL 6, 2005	sheet	1
4	HEALTH DEPT. COMMENTS		
3	JANUARY 31, 2005		
	HEALTH DEPT. APPLICATION		
	DECEMBER 15, 2004		
2	VILLAGE COMMENTS		
1	APRIL 5, 2004		
	W.C.H.D. COMMENTS		
date:	MARCH 1, 2004		
project no:	CRT 600		



UNAUTHORIZED ADDITIONS, MODIFICATIONS AND/OR ALTERNATIONS TO THESE PLANS IS A VIOLATION SECTION 7209(2) OF THE NEW YORK STATE EDUCATION LAW.